



**1** SITE SIGNAGE IN BOLLARD  
C-261 SCALE: N.T.S.


NOTE: ACCESSIBLE PARKING SIGNAGE MUST BE A MINIMUM 60 INCHES FROM THE GROUND SURFACE MEASURED TO THE BOTTOM OF THE SIGN. (SEE DETAIL 1 ON THIS SHEET)

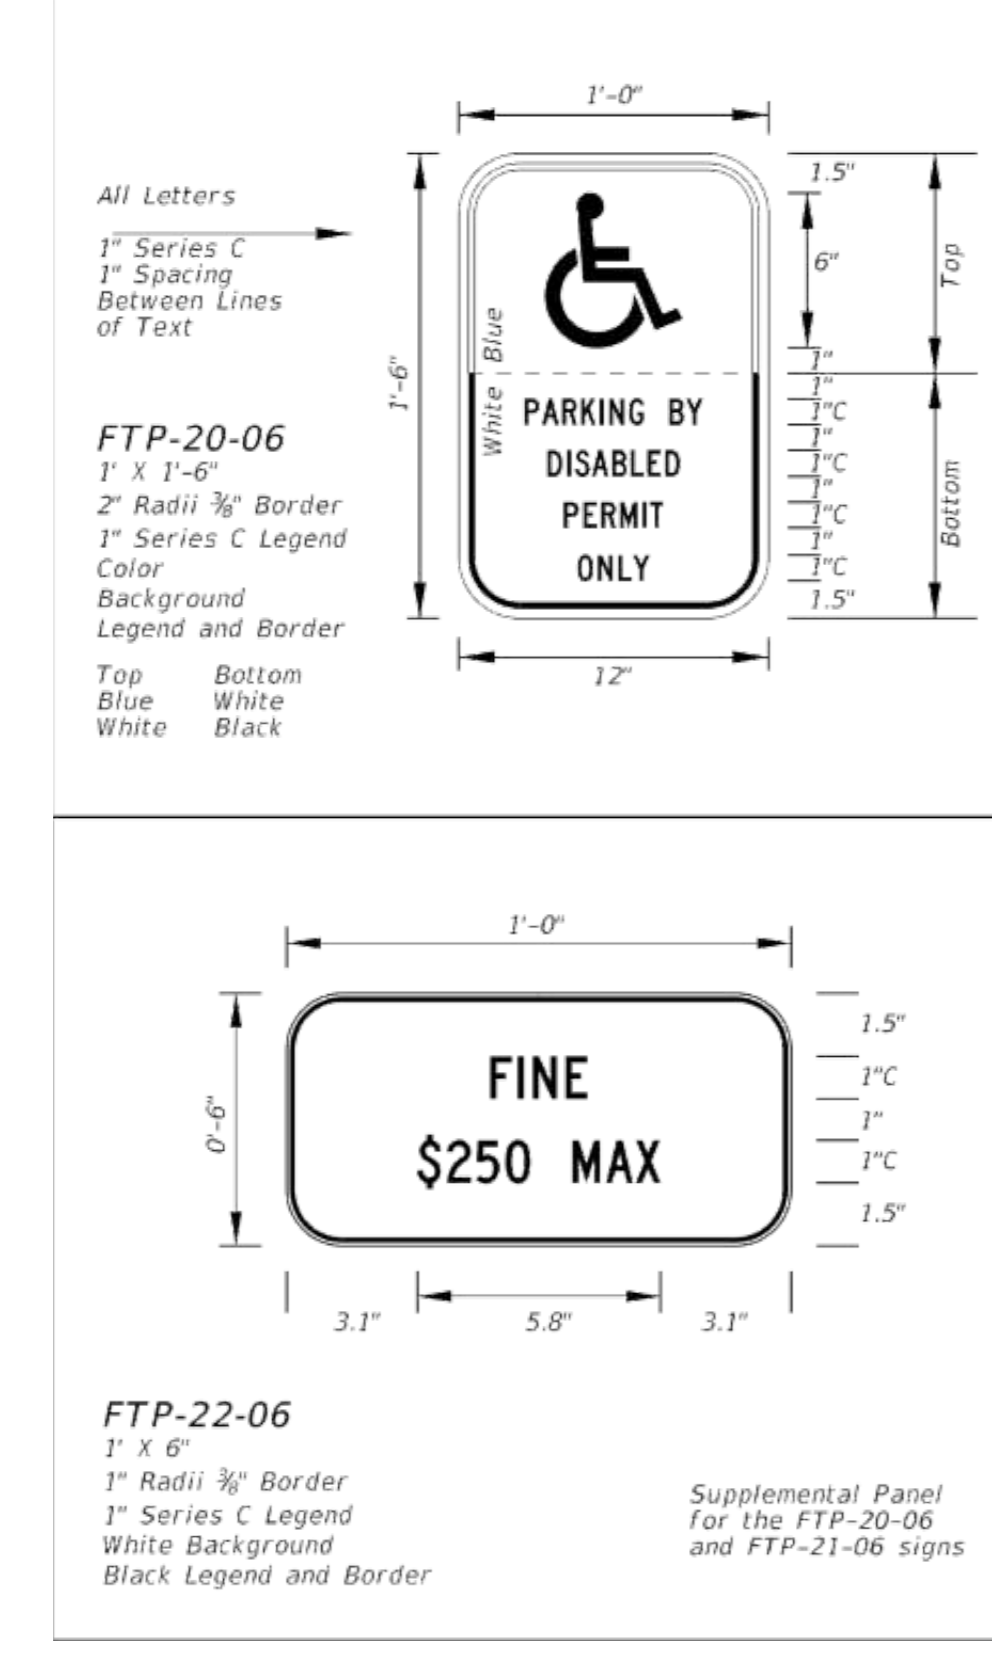


**2** ACCESSIBLE PARKING SIGNAGE  
C-261 SCALE: N.T.S.

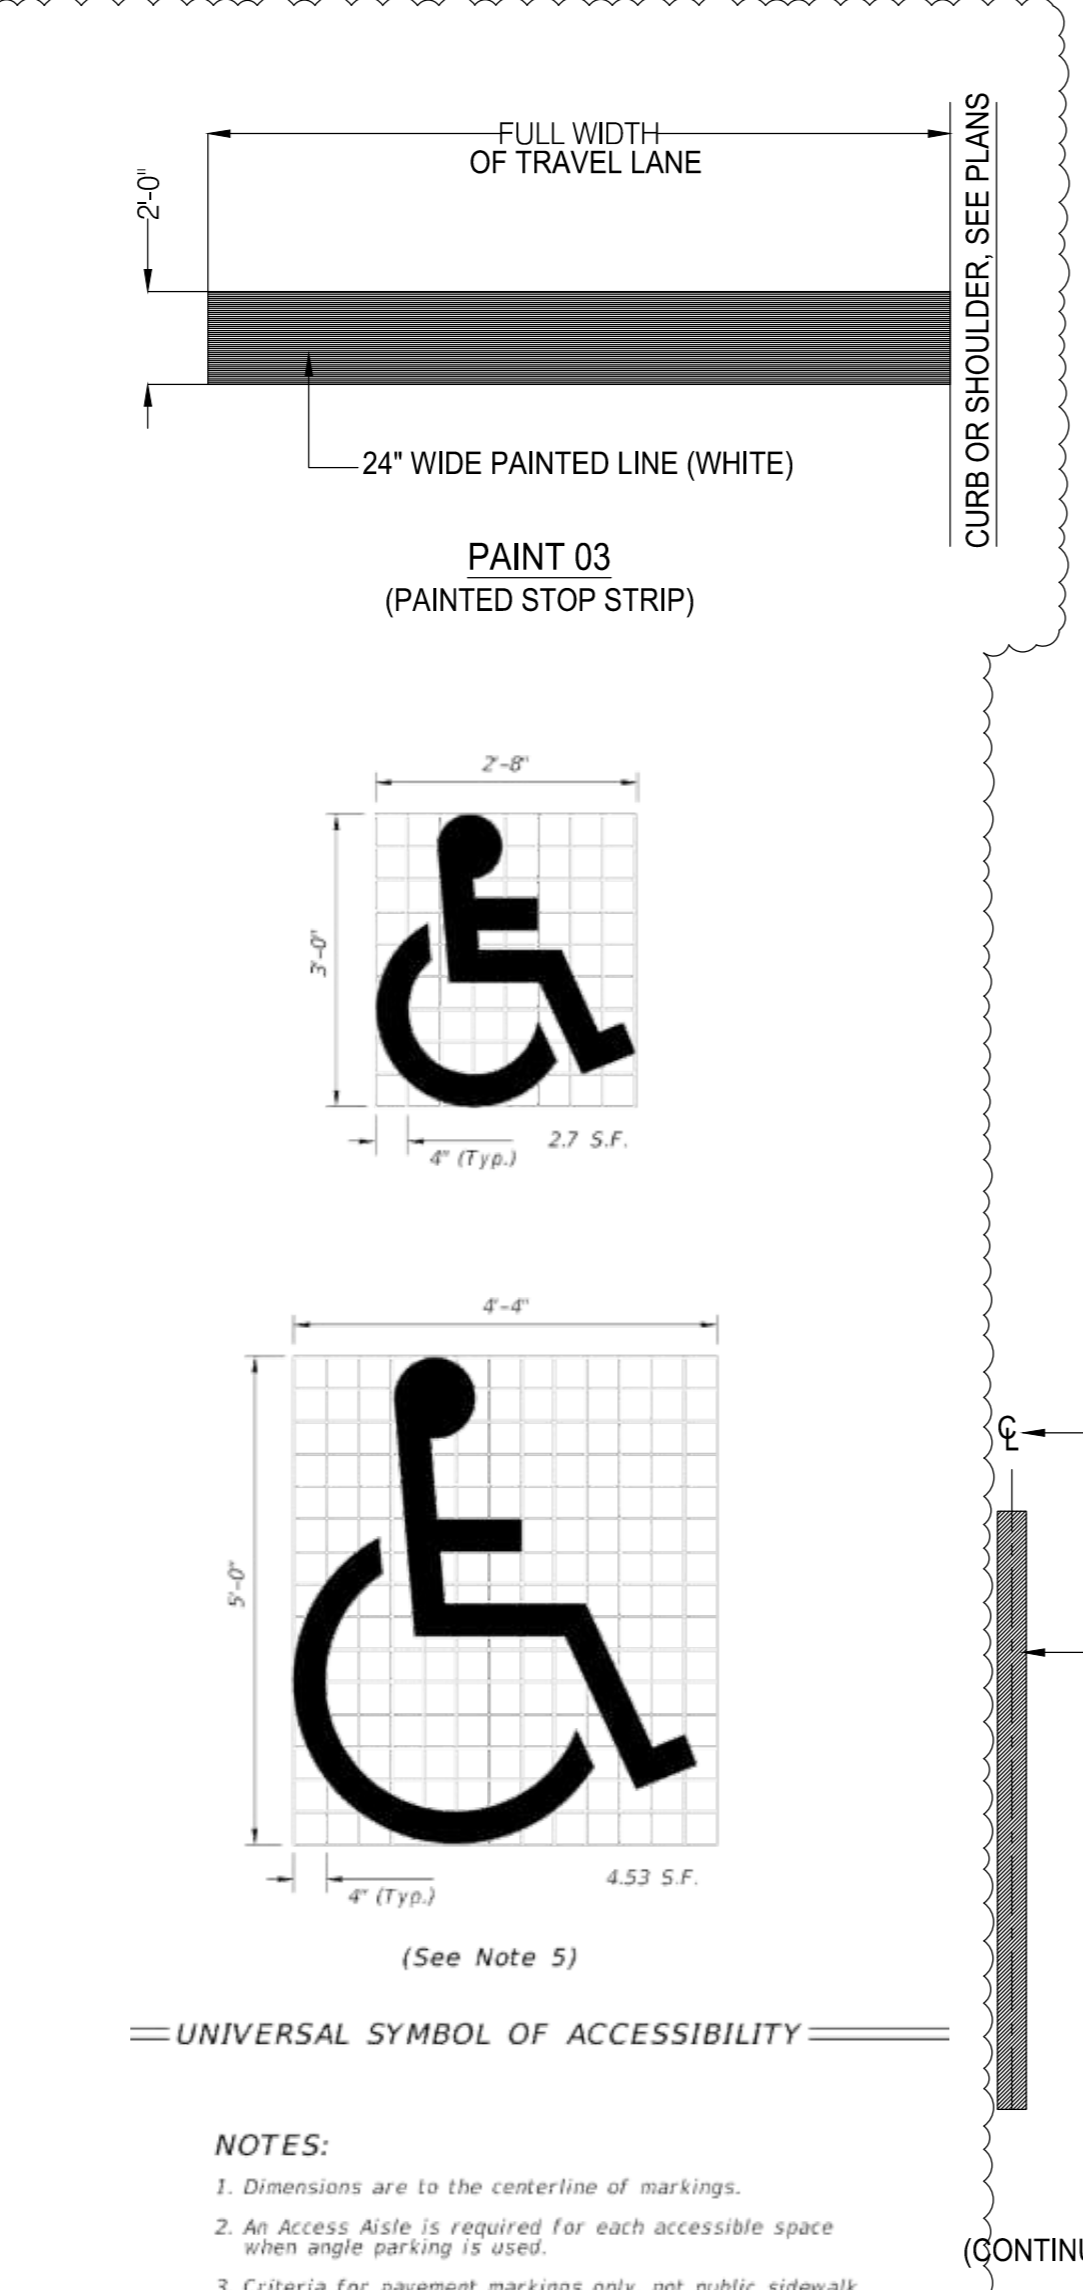

**3** PAVEMENT PAINT MARKINGS  
C-261 SCALE: N.T.S.

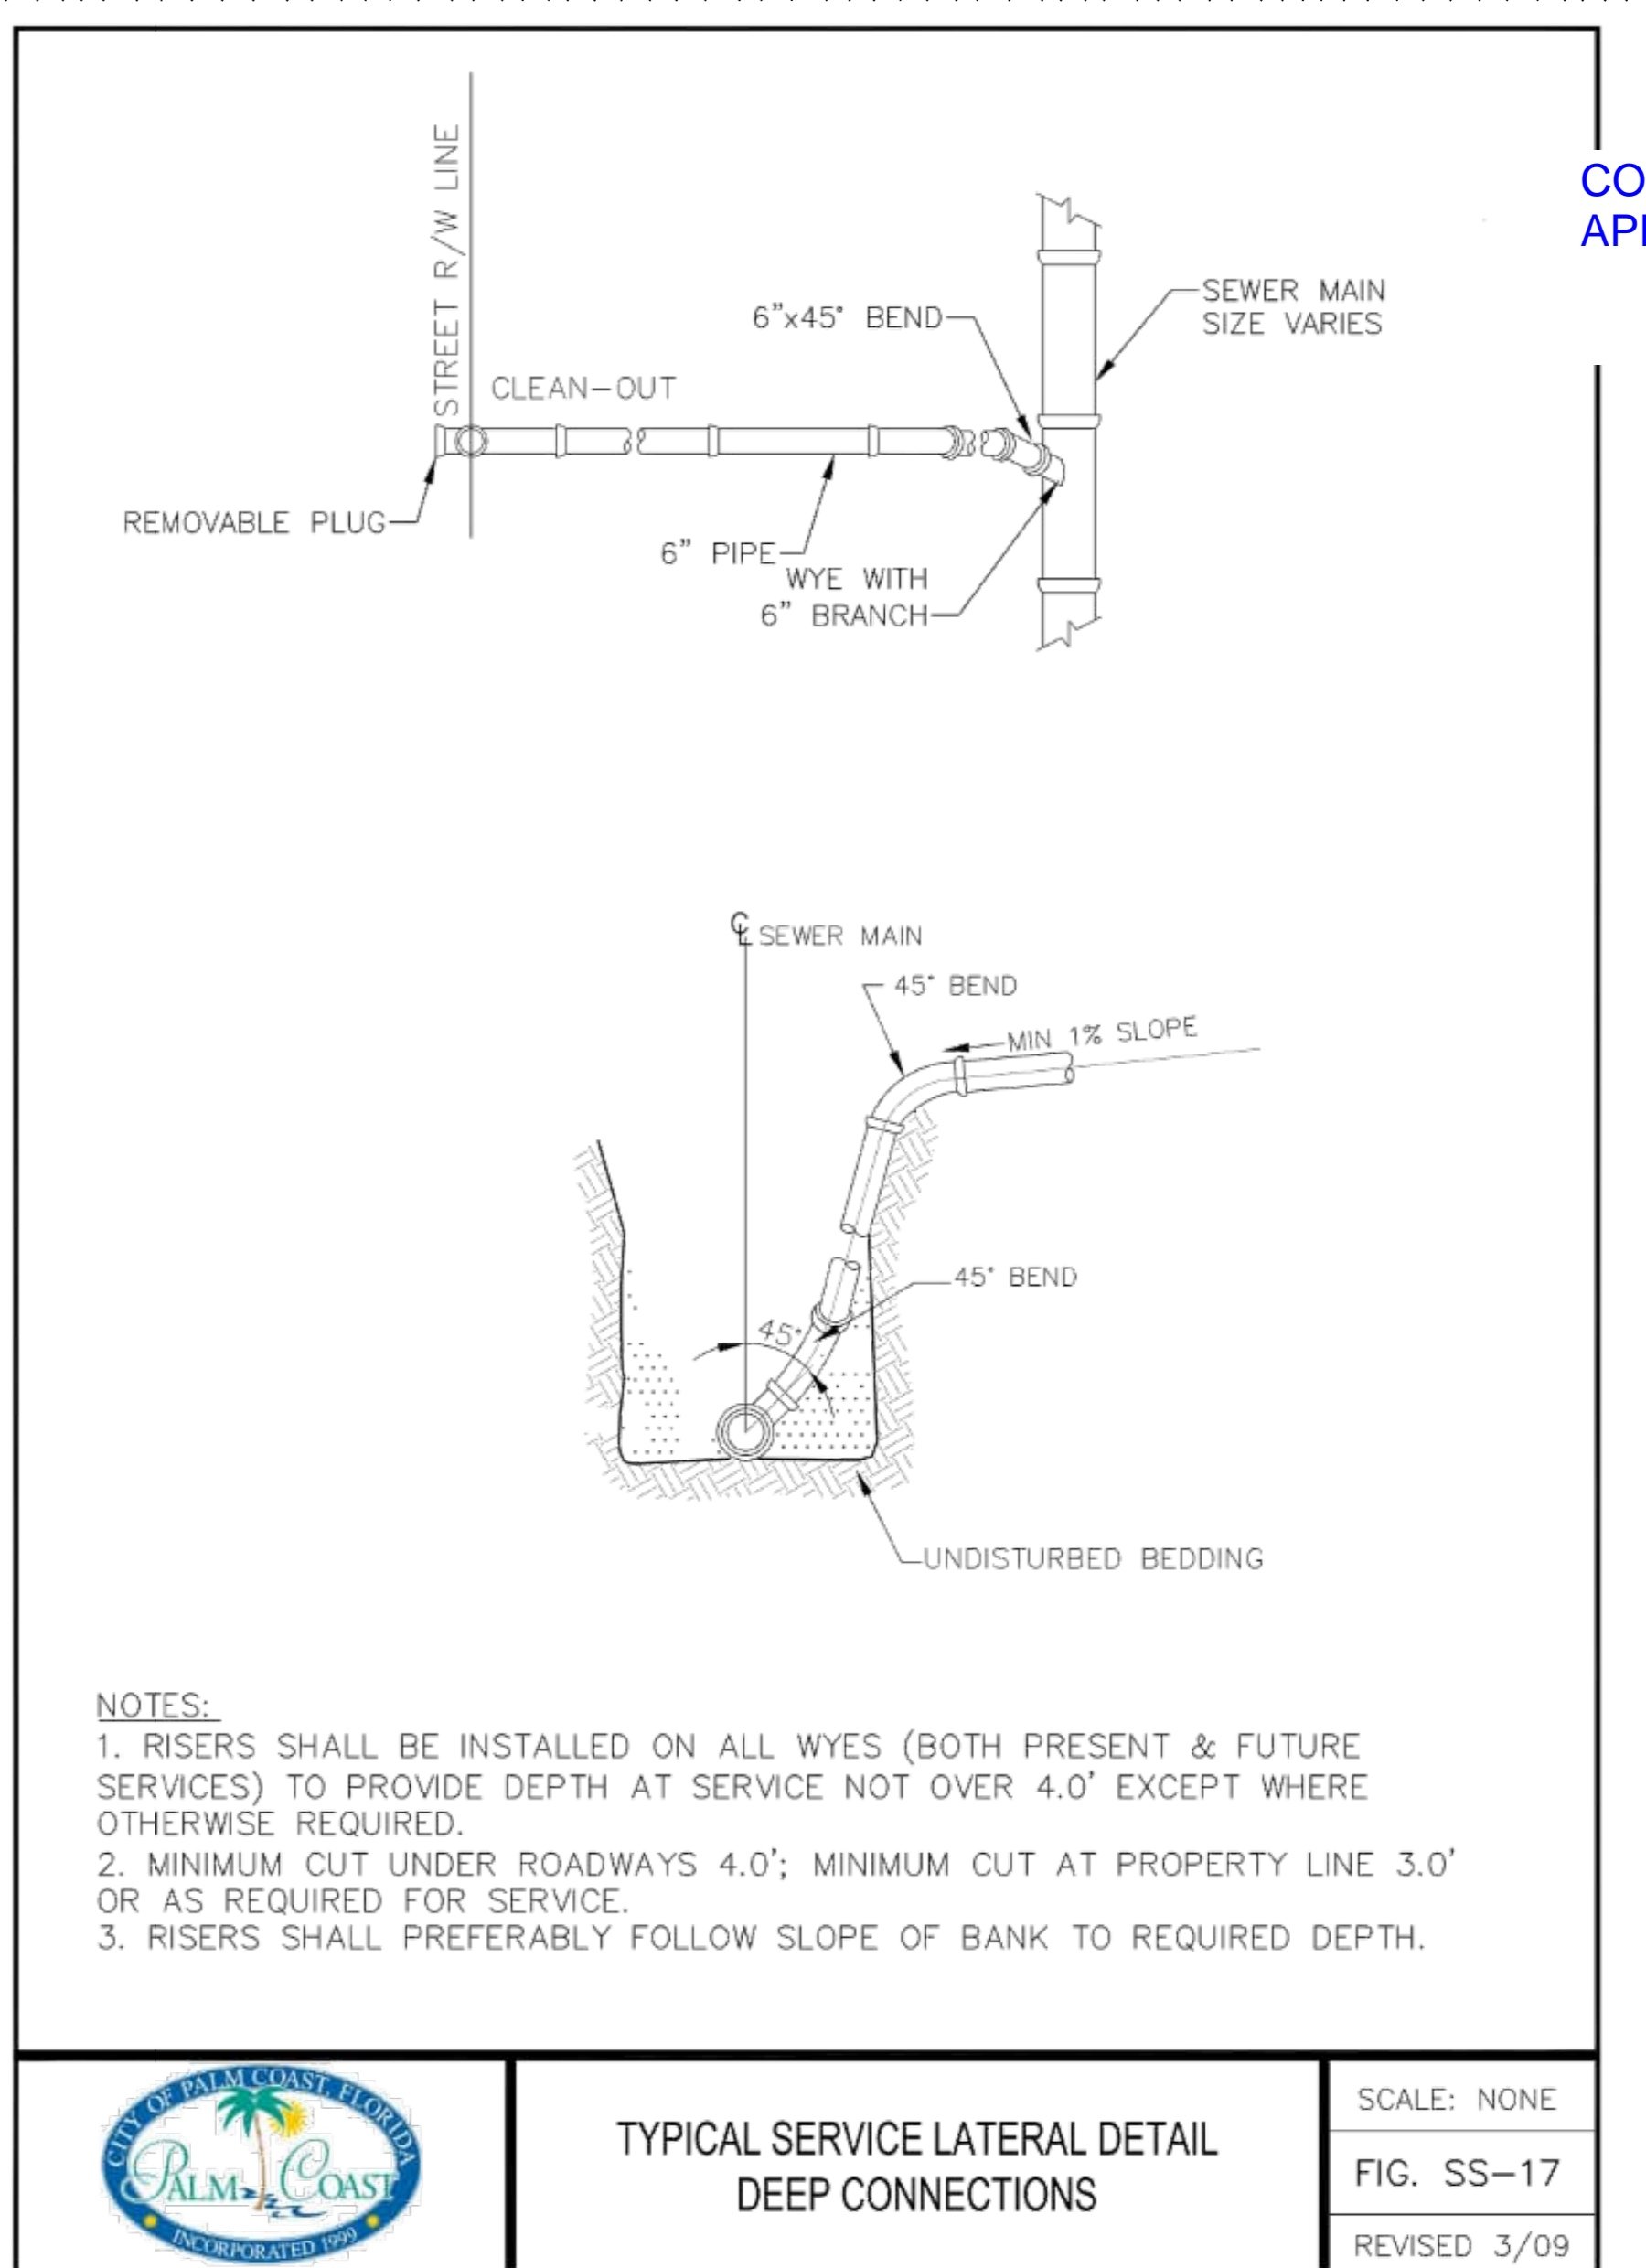


**4** TYPICAL SERVICE LATERAL DETAIL - DEEP CONNECTIONS  
C-261 SCALE: N.T.S.

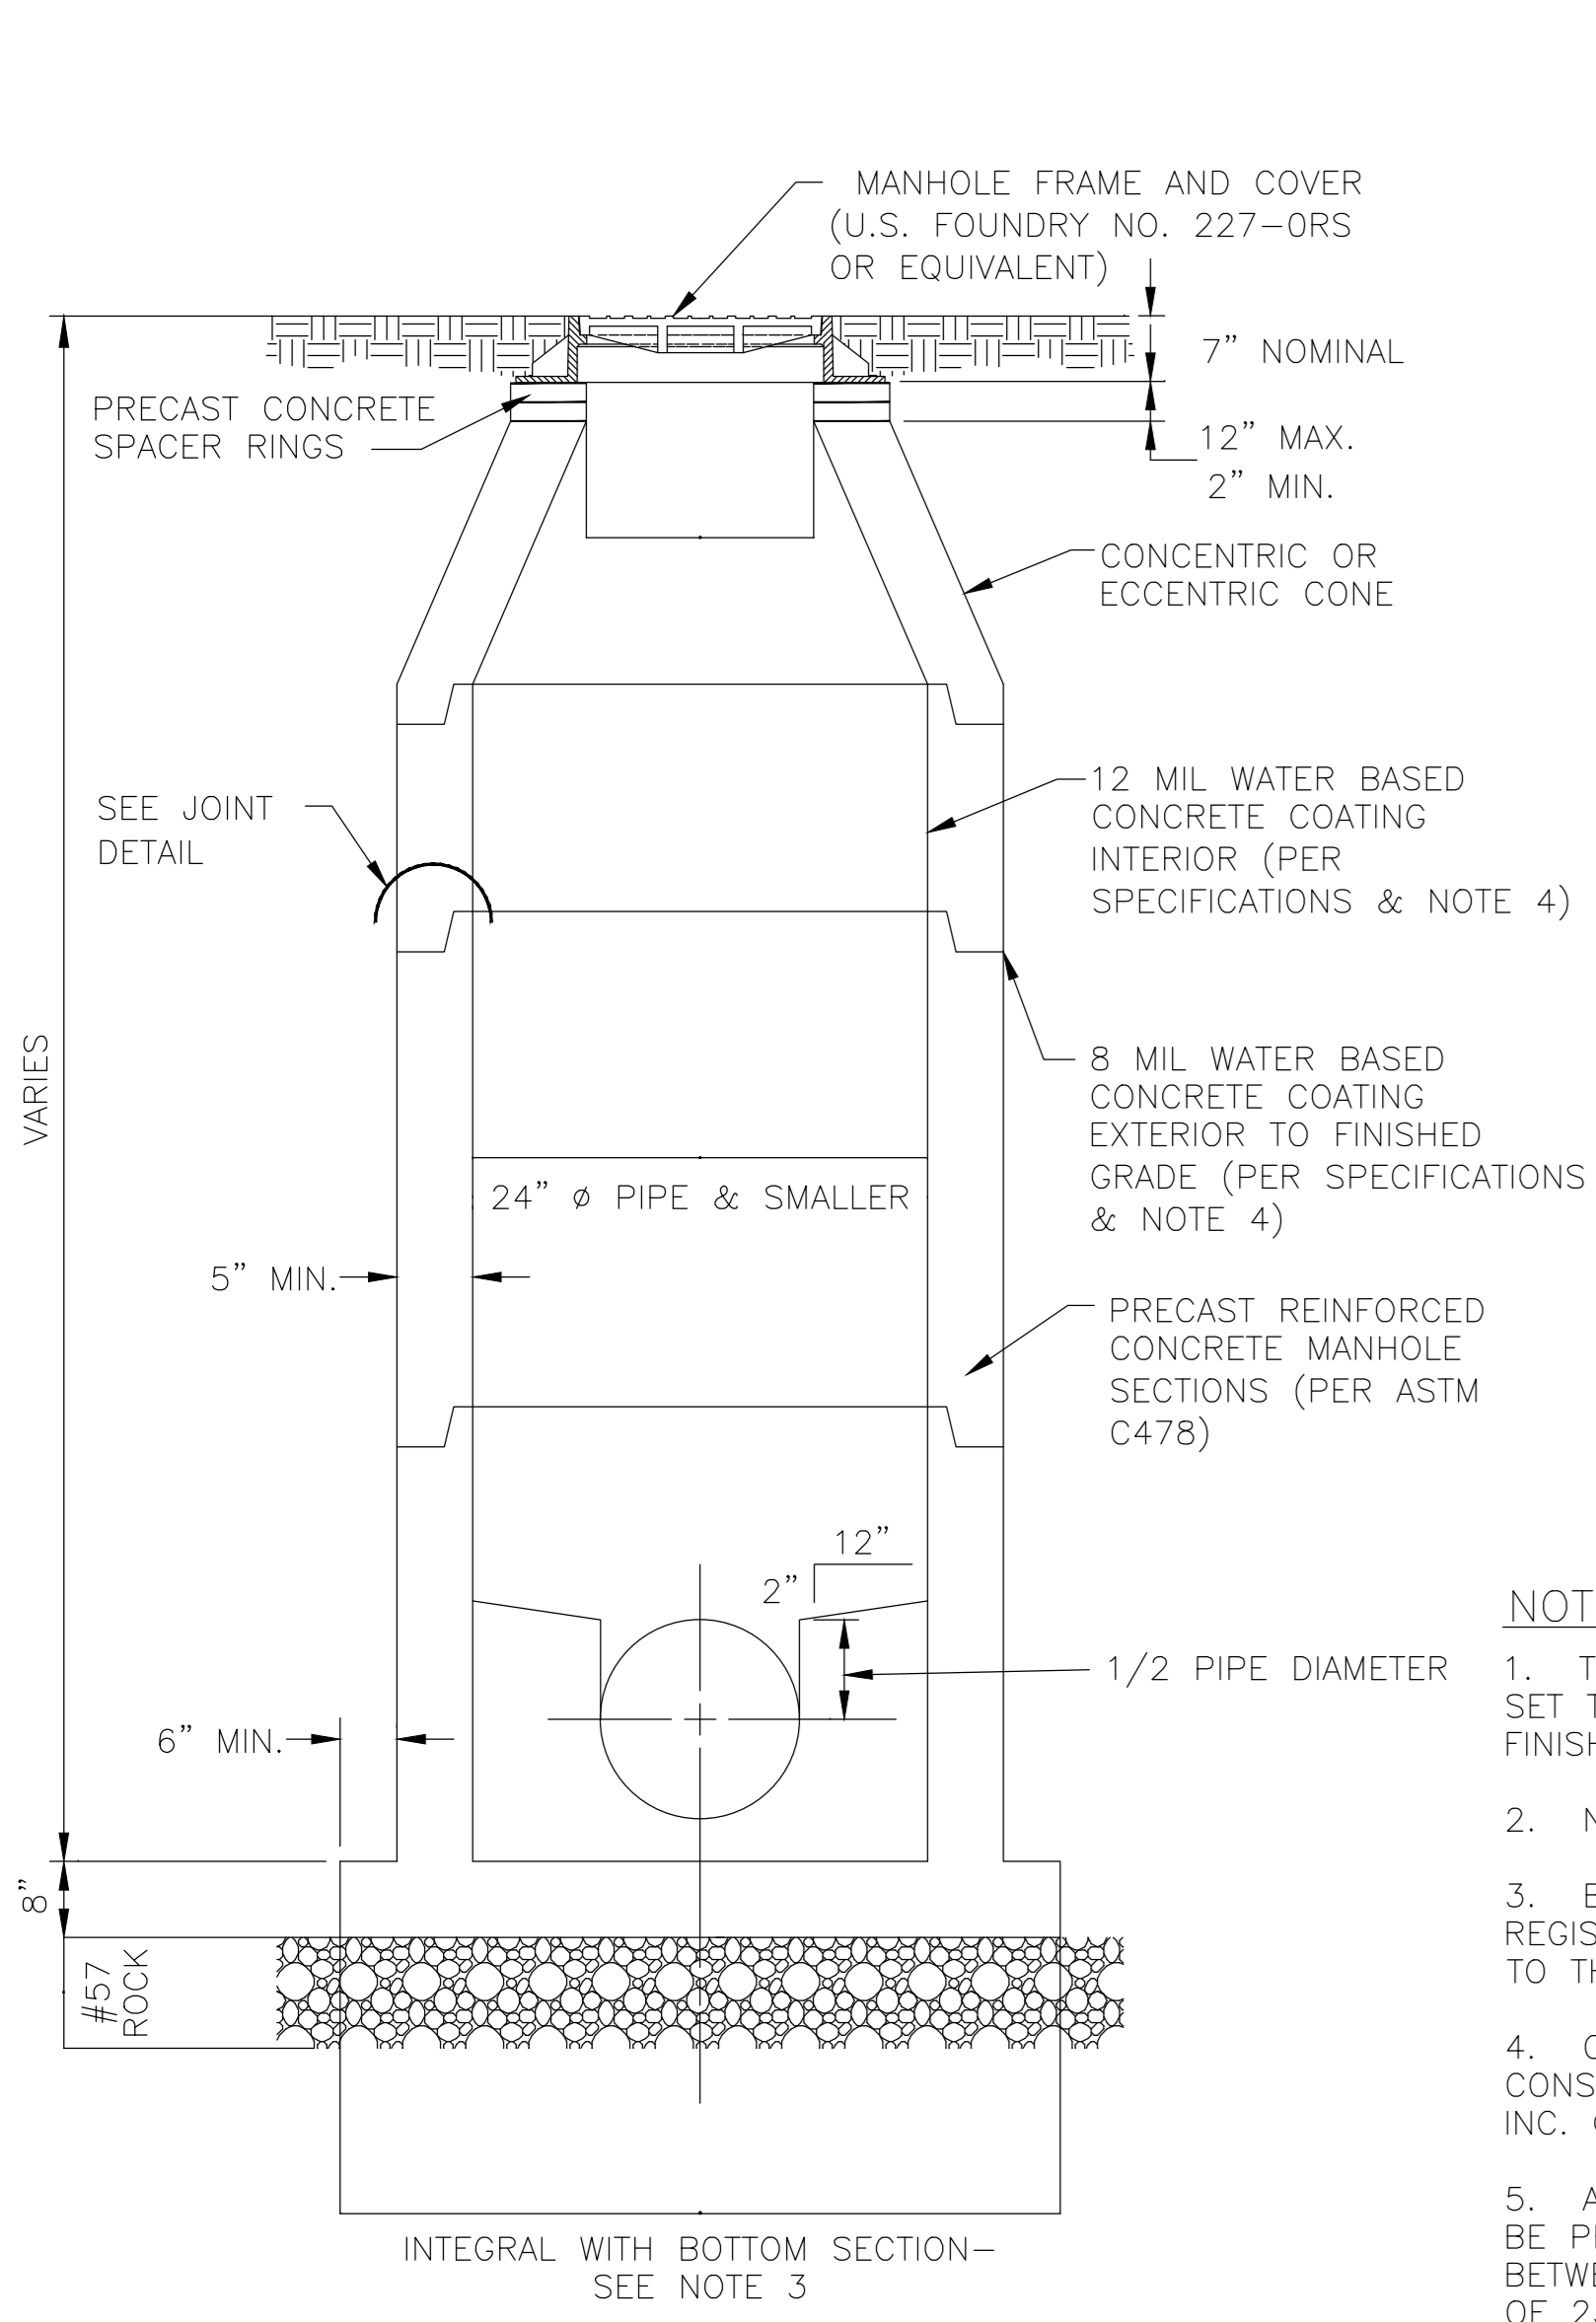


NOTES:  
1. TOPS OF MANHOLE FRAME AND COVERS SHALL BE SET TO THE FINISHED ROADWAY ELEVATION, FINISHED GRADE OR AS OTHER-WISE NOTED.  
2. NO PENETRATING HOLES THROUGH MANHOLES.  
3. BOTTOM SLAB SHALL BE DESIGNED BY A FLORIDA REGISTERED PROFESSIONAL ENGINEER AND SUBMITTED TO THE CITY FOR REVIEW.  
4. CONCRETE COATING SHALL BE EQUIVALENT TO CONSEAL CS-55 AS MFD. BY CONCRETE SEALANTS, INC. COATING SHALL BE GRAY.  
5. A CONCRETE FILLET, SLIDE OR PVC FLUME SHALL BE PROVIDED WITHIN THE MANHOLE FOR DIFFERENCES BETWEEN THE INFLUENT SEWER AND MANHOLE INVERT OF 23 INCHES OR LESS.

**5** SANITARY SEWER MANHOLE  
C-261 SCALE: N.T.S.

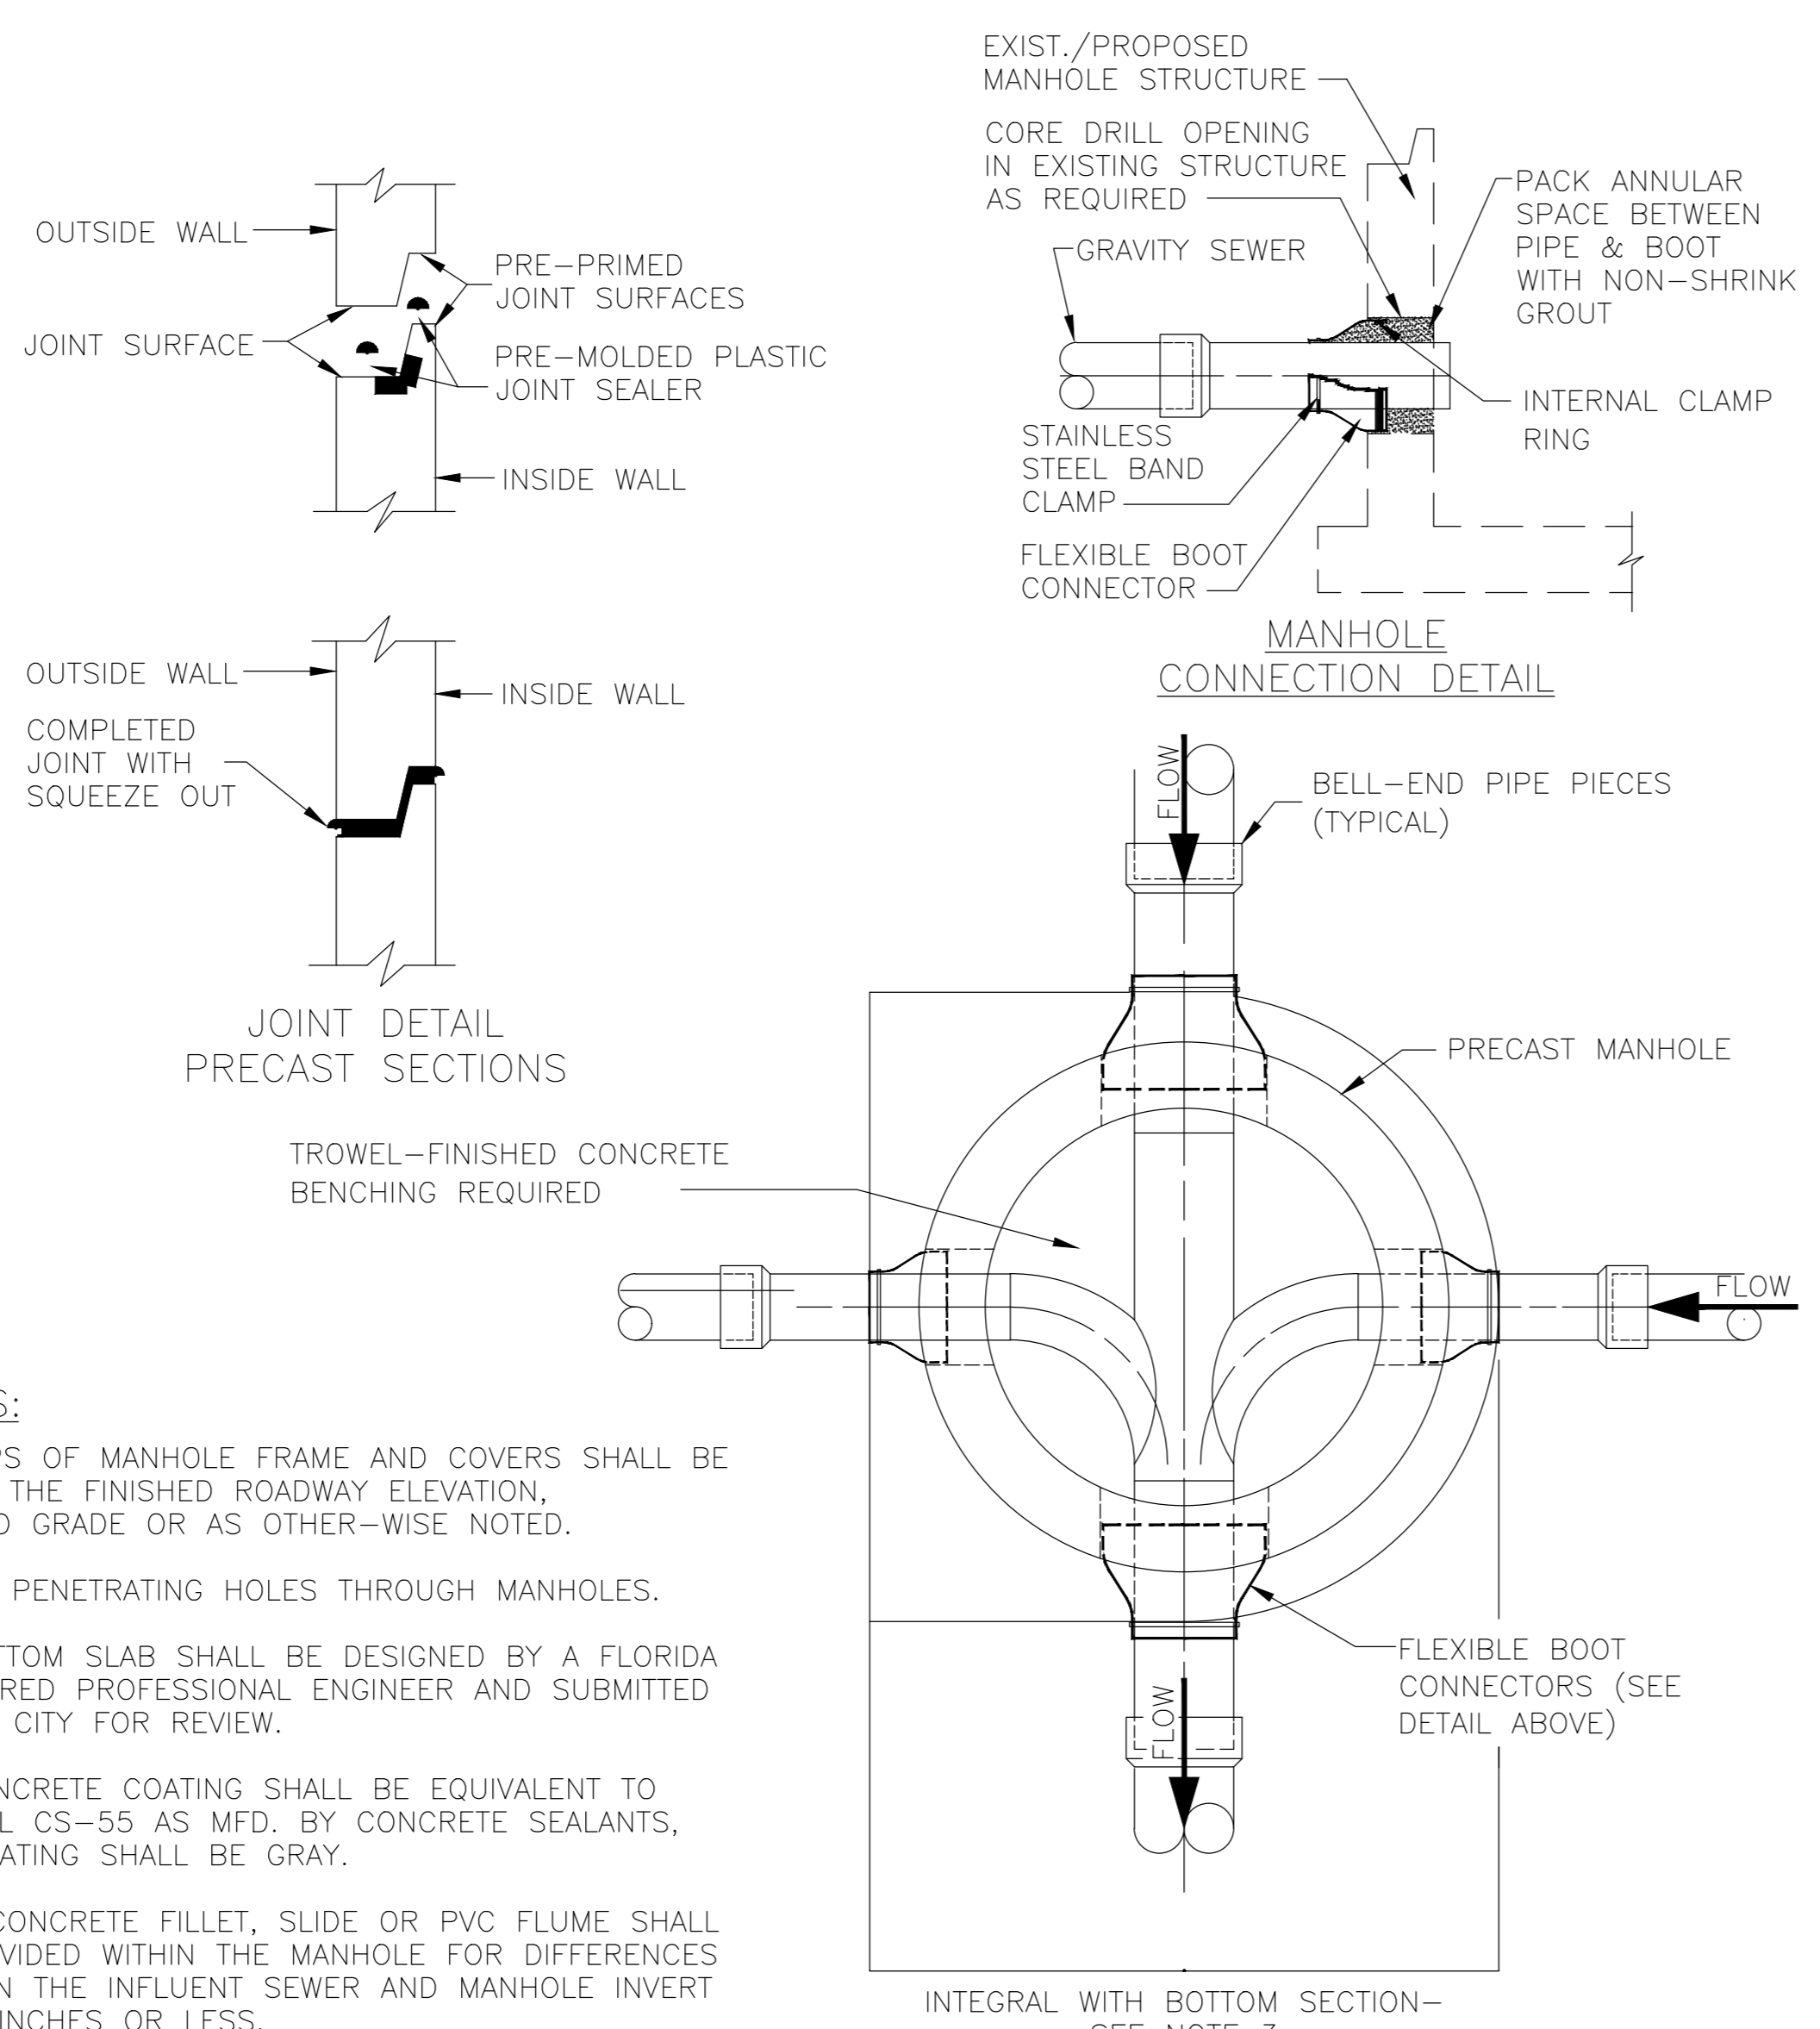


TYPICAL MANHOLE PLAN

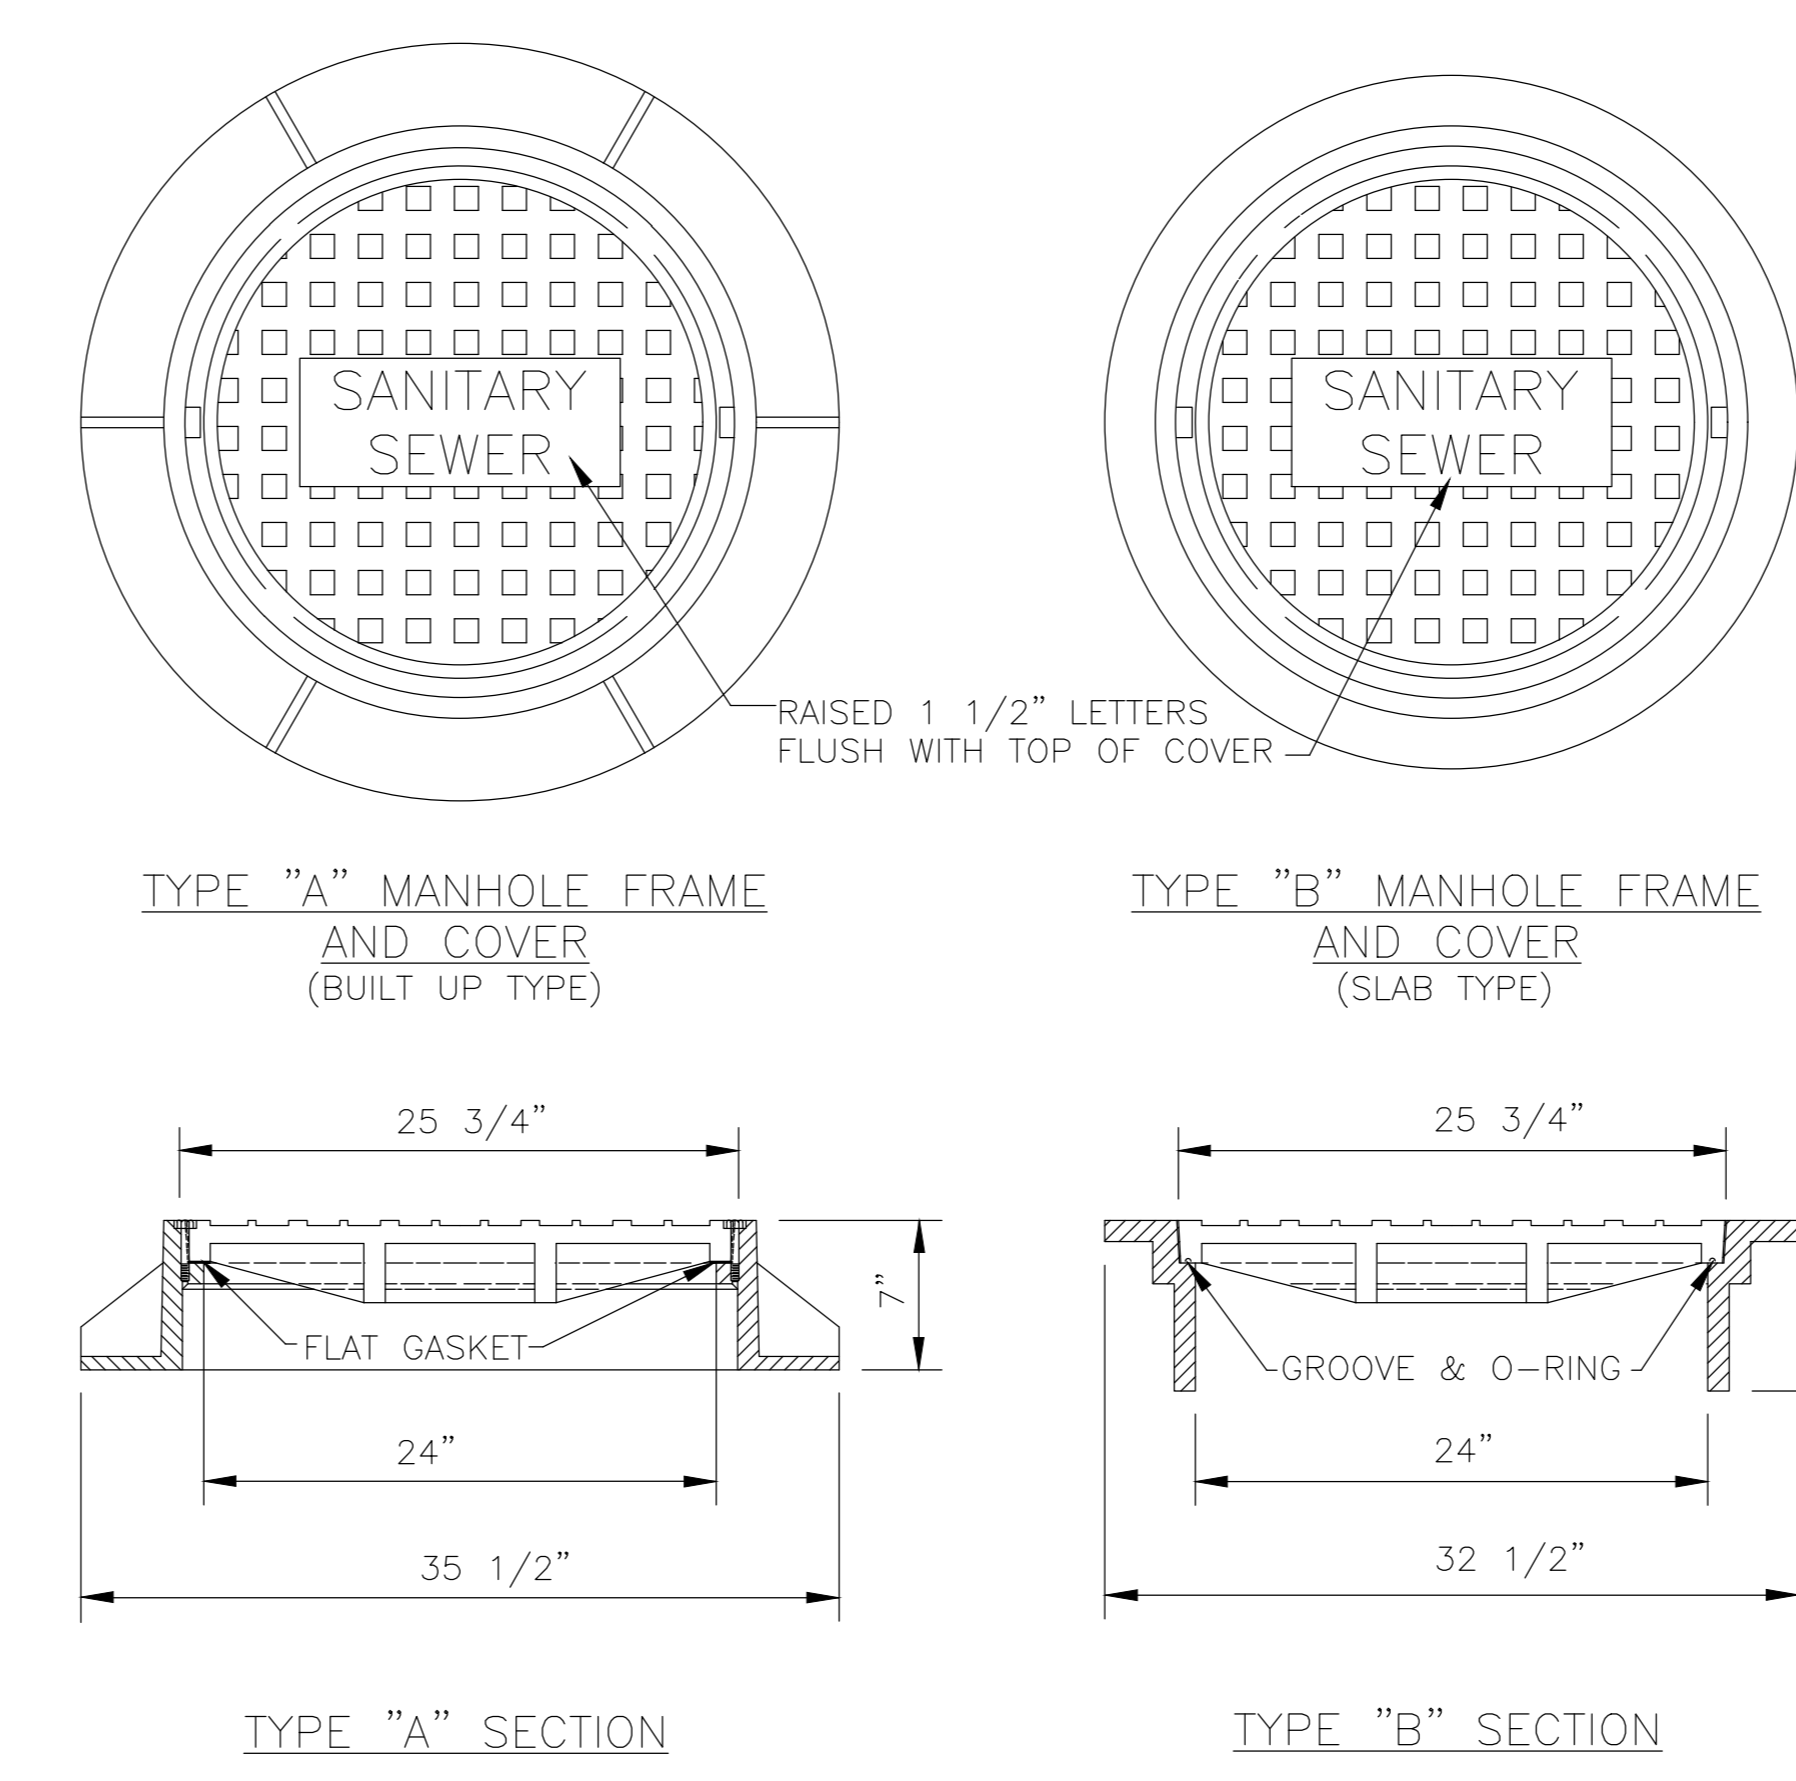

NOTES:  
1. TYPE "A" & "B" NON-BOLTED WATERTIGHT RING & COVER. US FOUNDRY NO. 227-AS-ORS (TYPE "A") & U.S. FOUNDRY NO. 1295-AS-ORS (TYPE "B") OR APPROVED EQUAL.  
2. MANHOLE COVERS SHALL BE LABELED AS SHOWN ABOVE.

**6** SANITARY SEWER MANHOLE FRAME AND COVER  
C-261 SCALE: N.T.S.

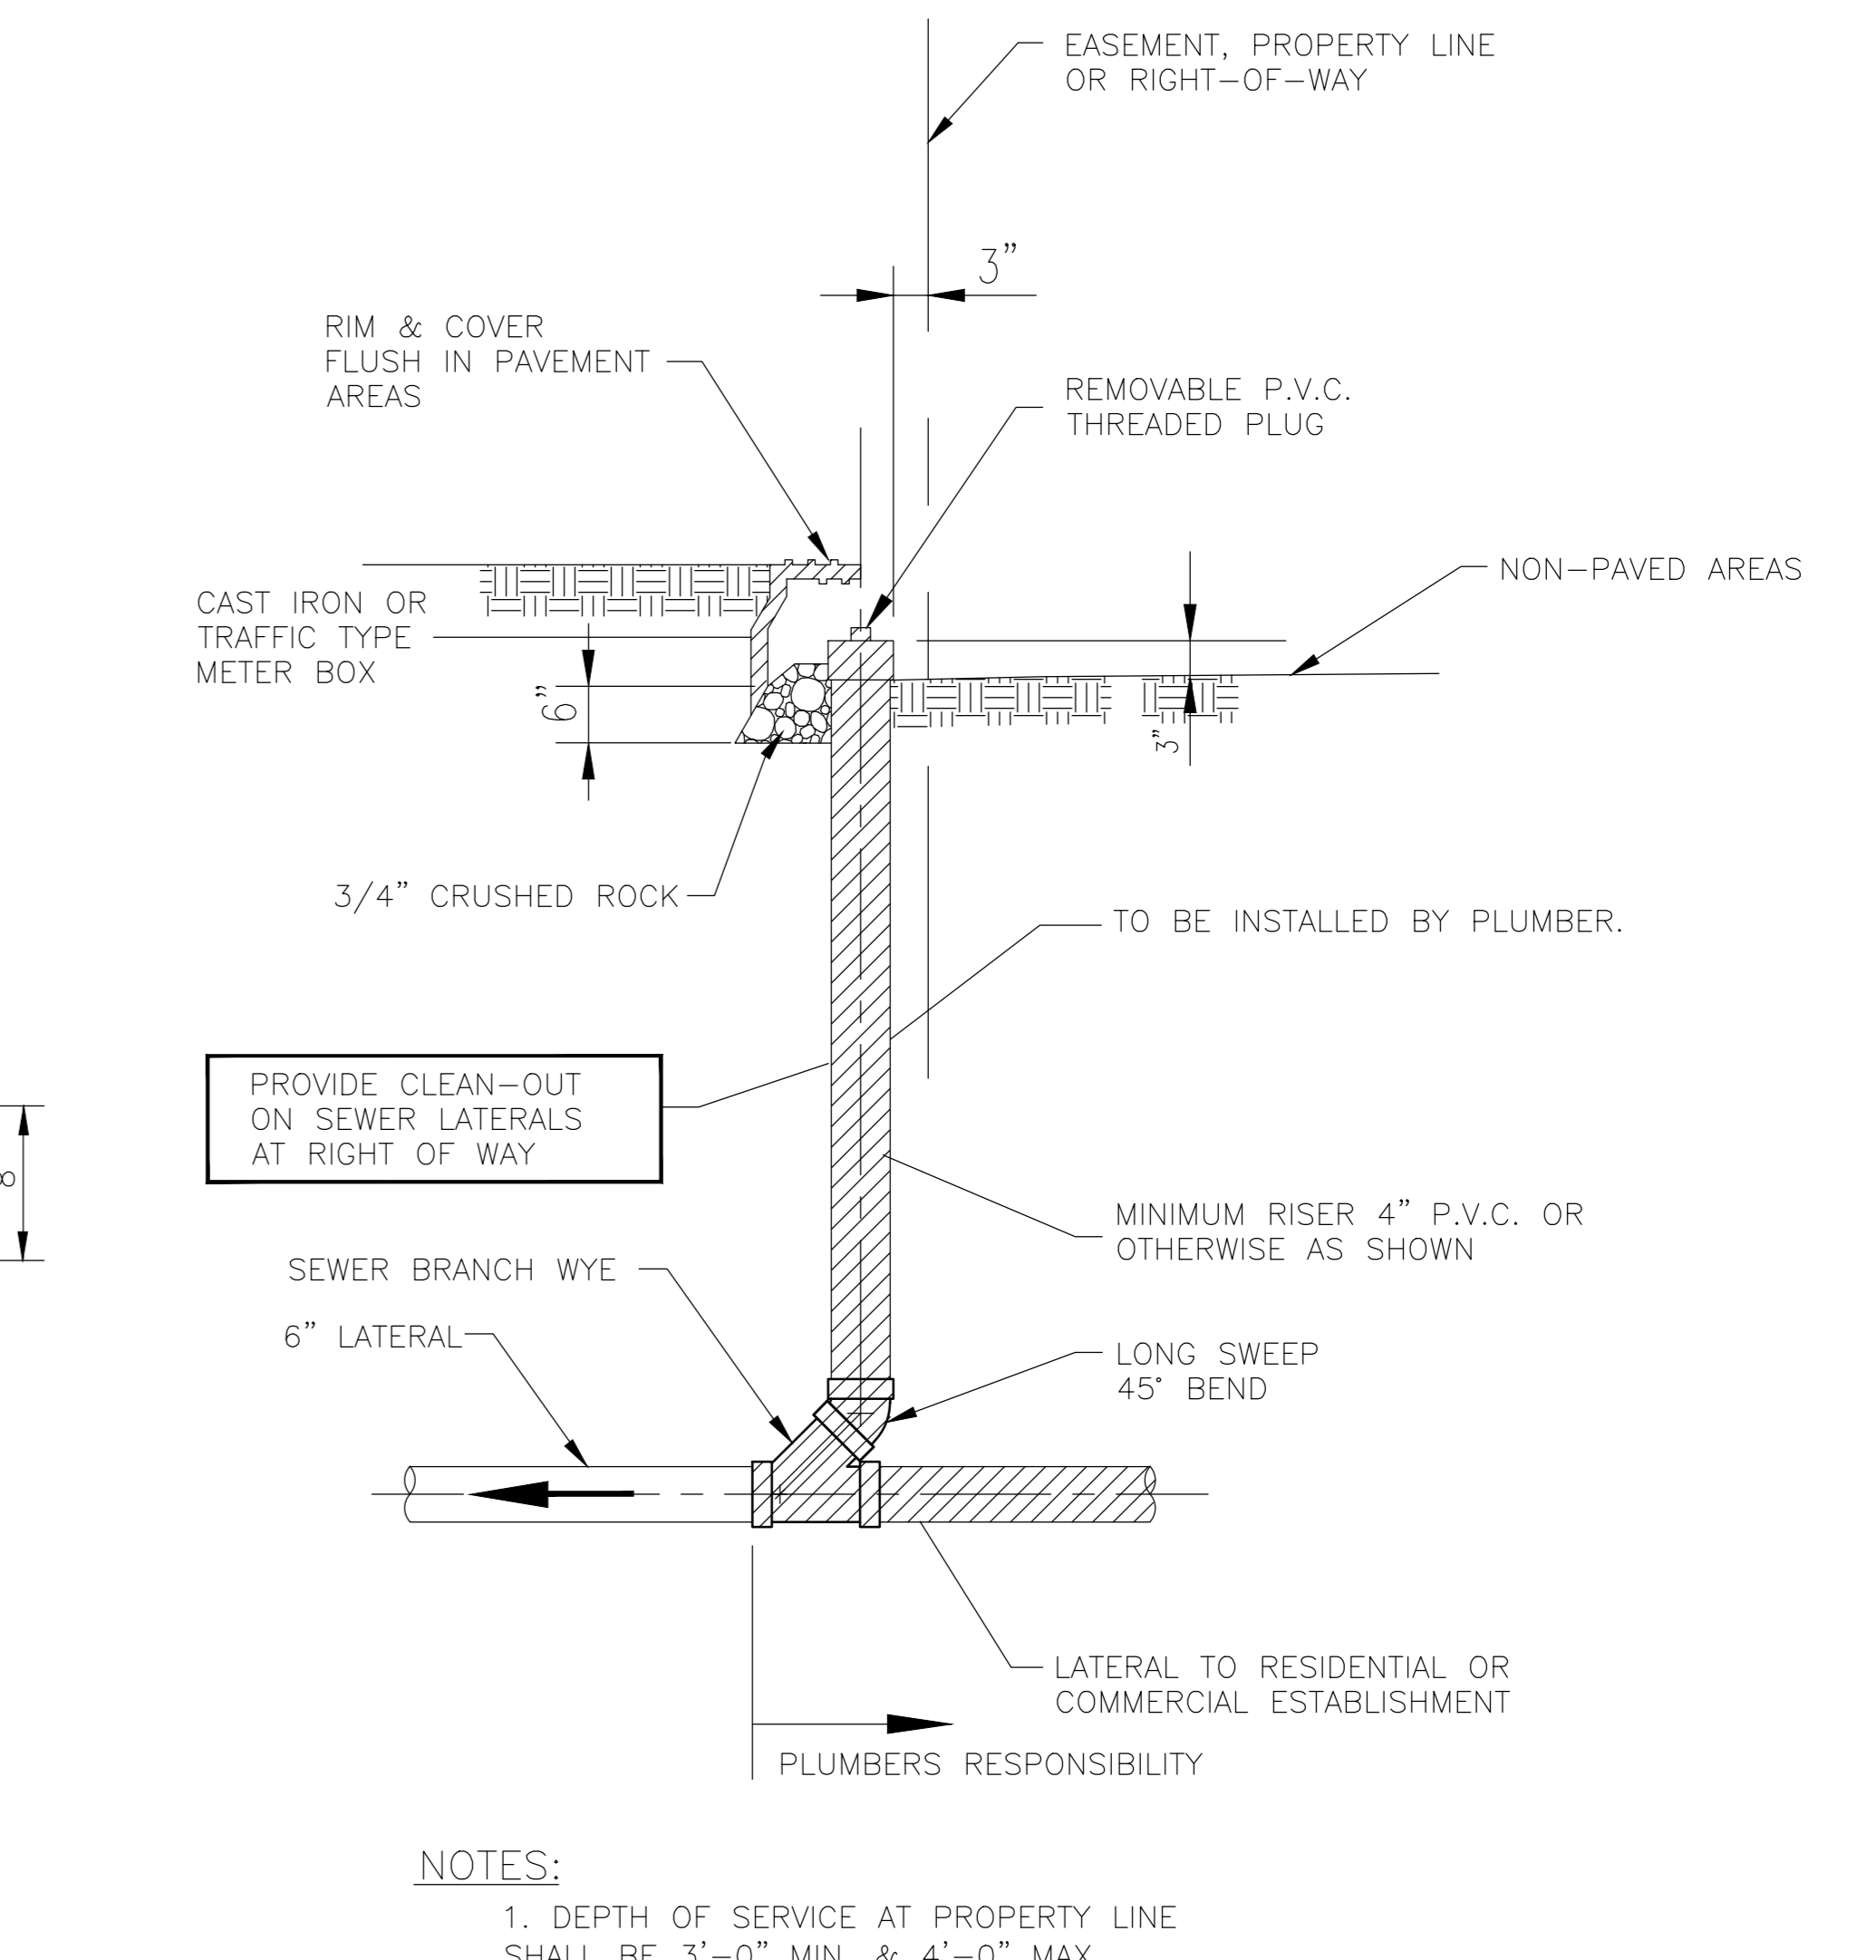

**7** SANITARY SEWER CLEANOUT  
C-261 SCALE: N.T.S.